



KEY PLANS

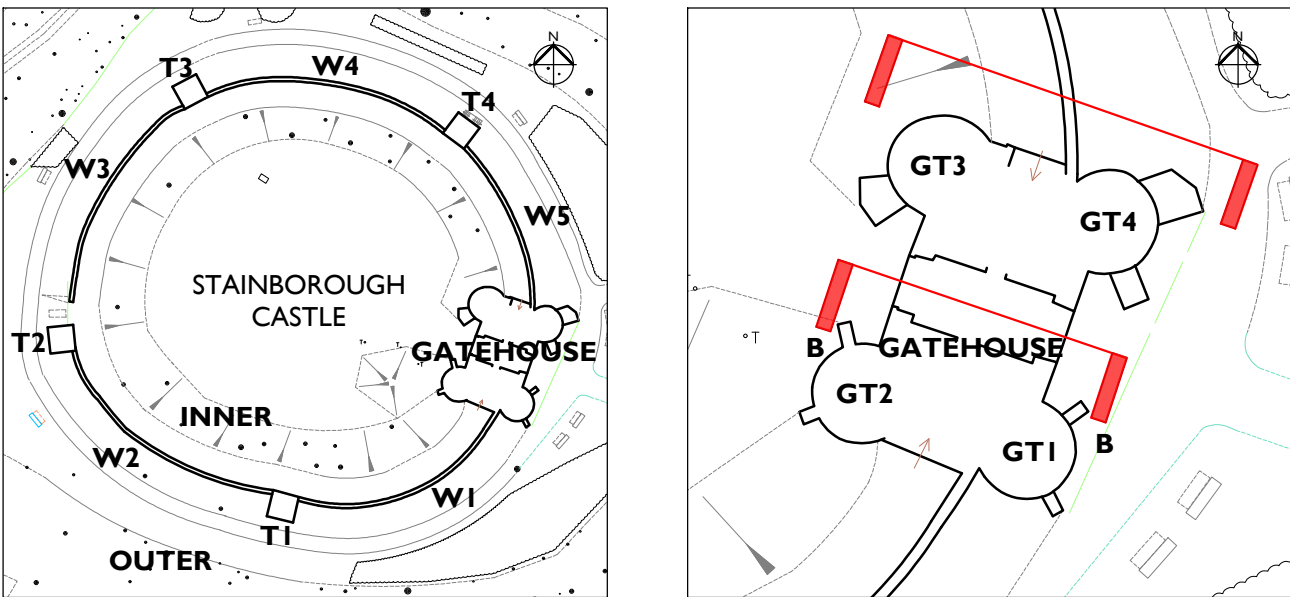


- BAT MITIGATION STRATEGY**
1. Crevices in stonework to be checked for signs of bats and roosting crevices prior to repointing. Any existing bat roosts to be retained and other suitable roost locations suitable for hibernation to be directed by Architect.
 2. Repointing of deep crevices should not be carried out during the winter months and deep crevices to be checked as work proceeds.
 3. Any remedial timber treatment should be carried out using chemicals listed on English Nature Safe List.
 4. Pre-treated timbers (tanalised and CCA etc.) should be dry and brushed to remove any crystalline residue before use.

GATEHOUSE TOWER GT1

GATEHOUSE TOWER GT2

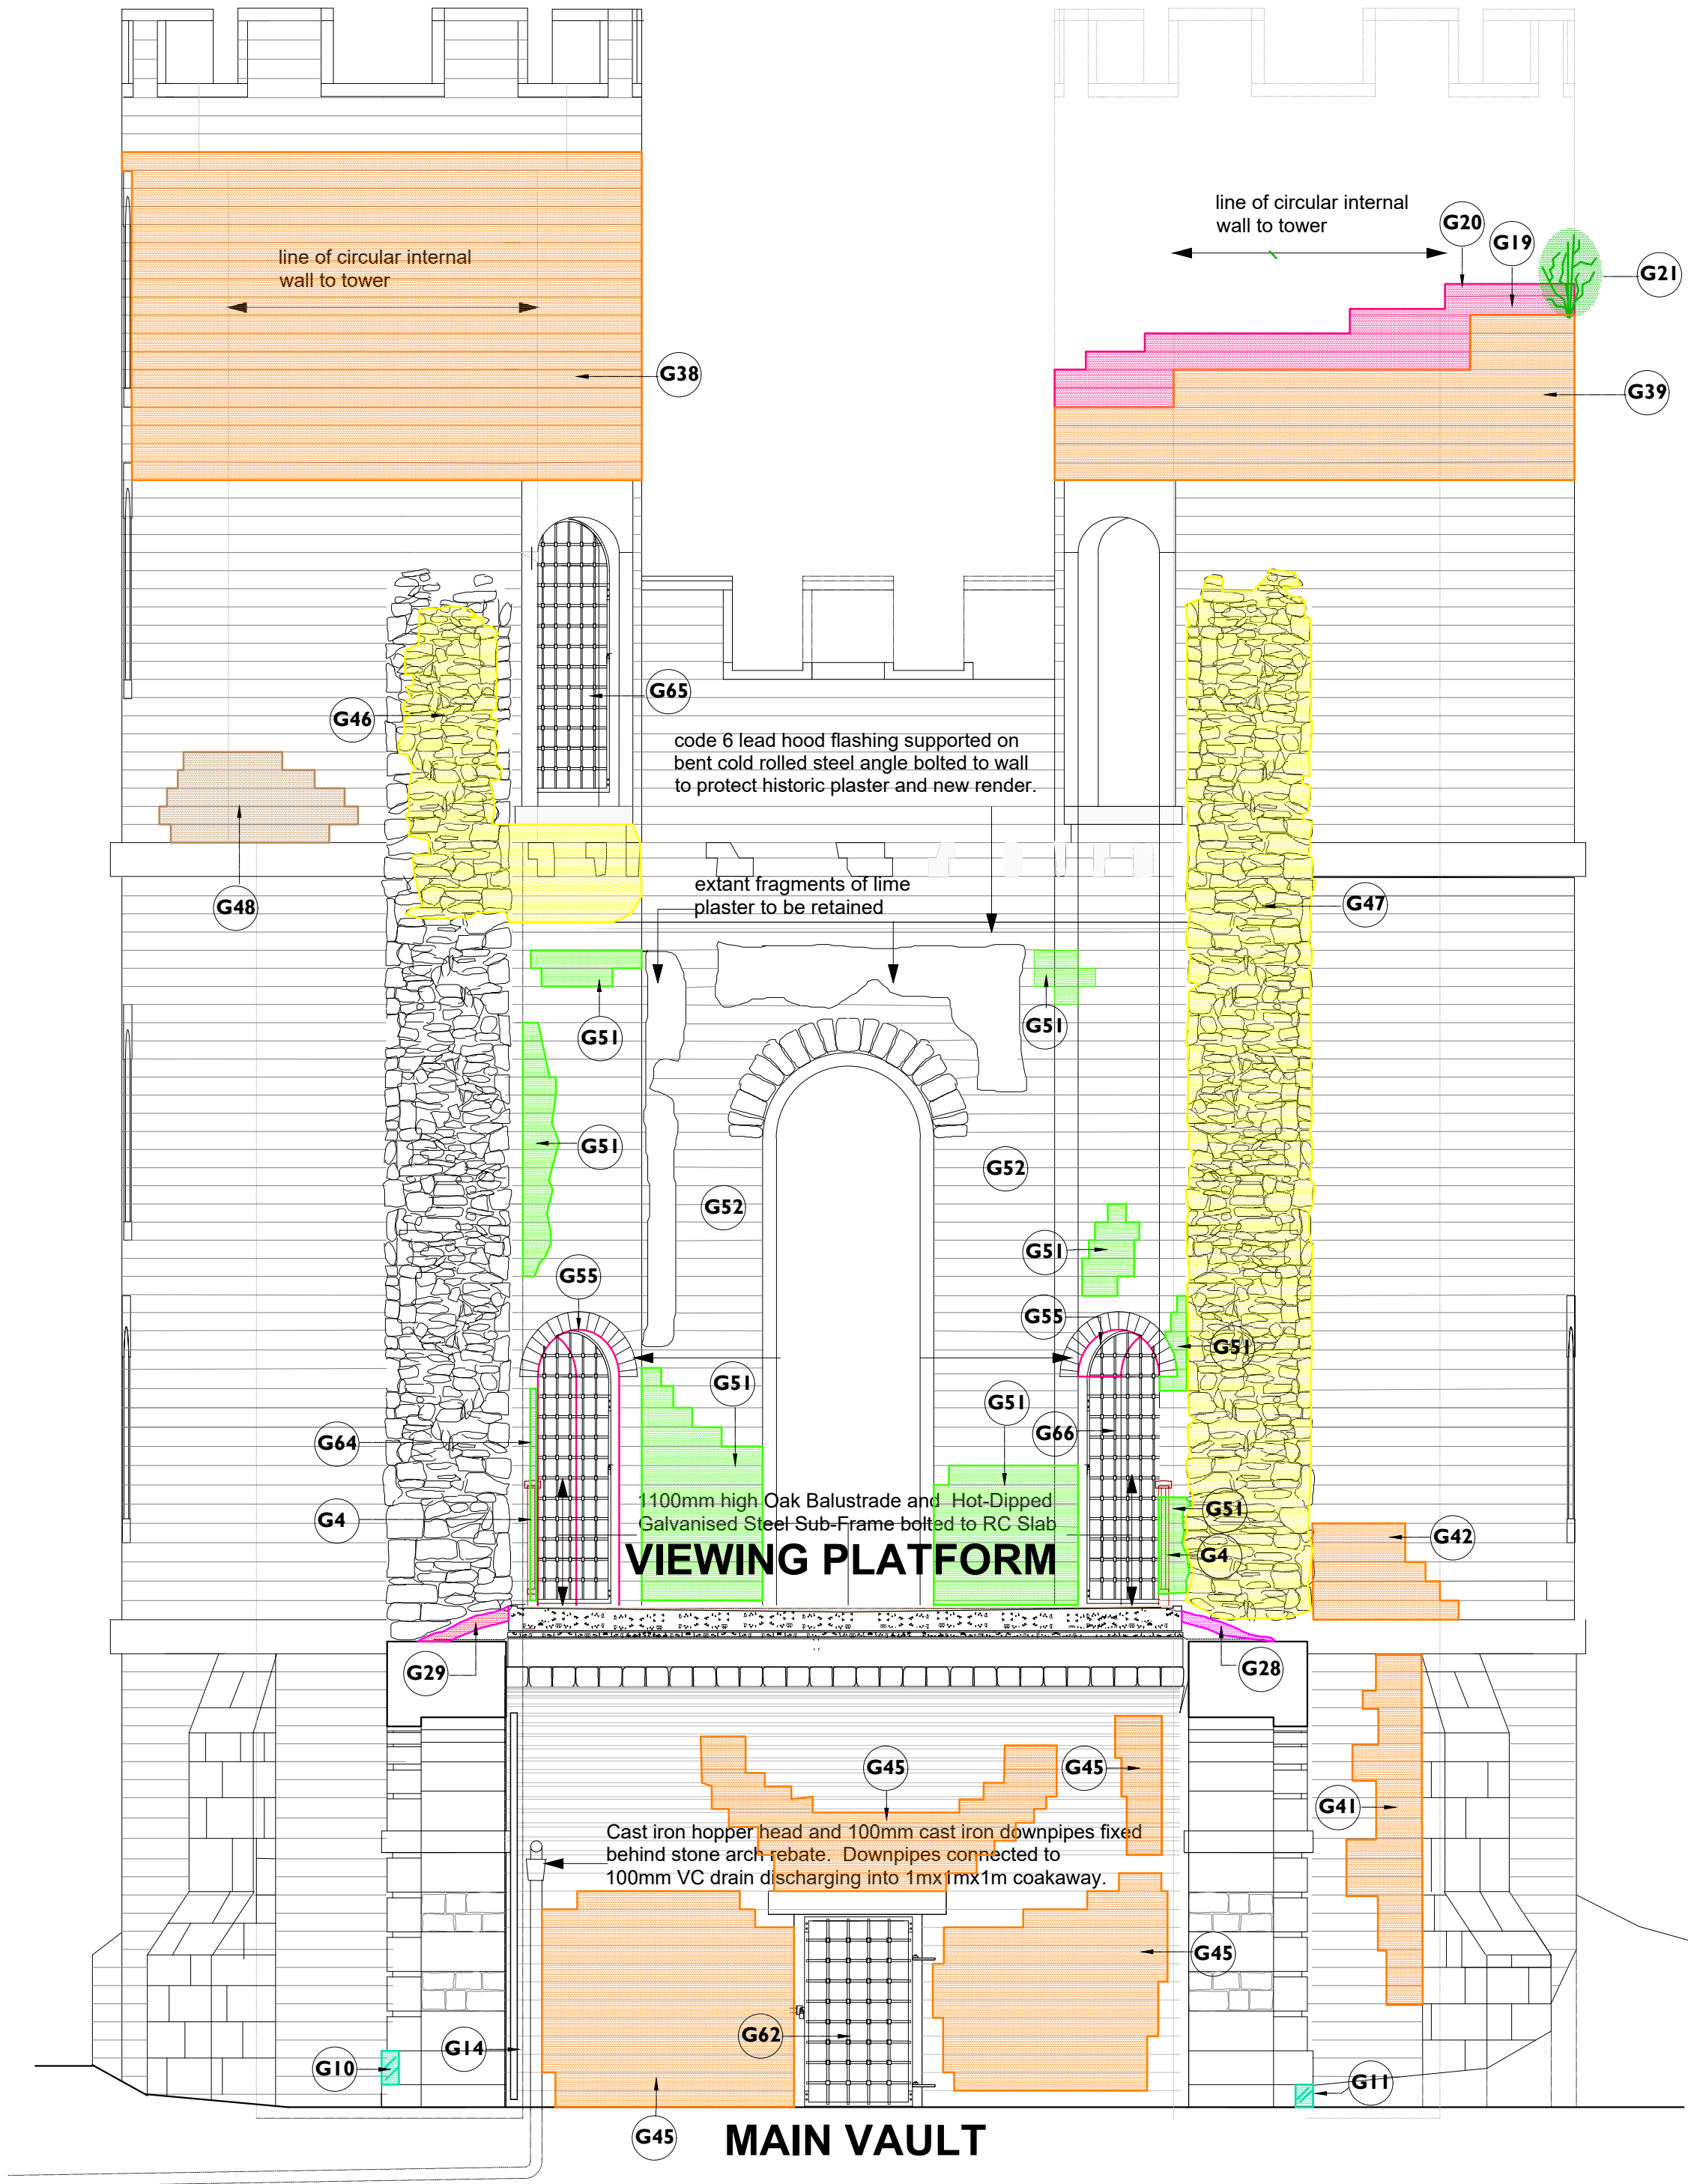

SECTION B-B THROUGH VAULT LOOKING SOUTH

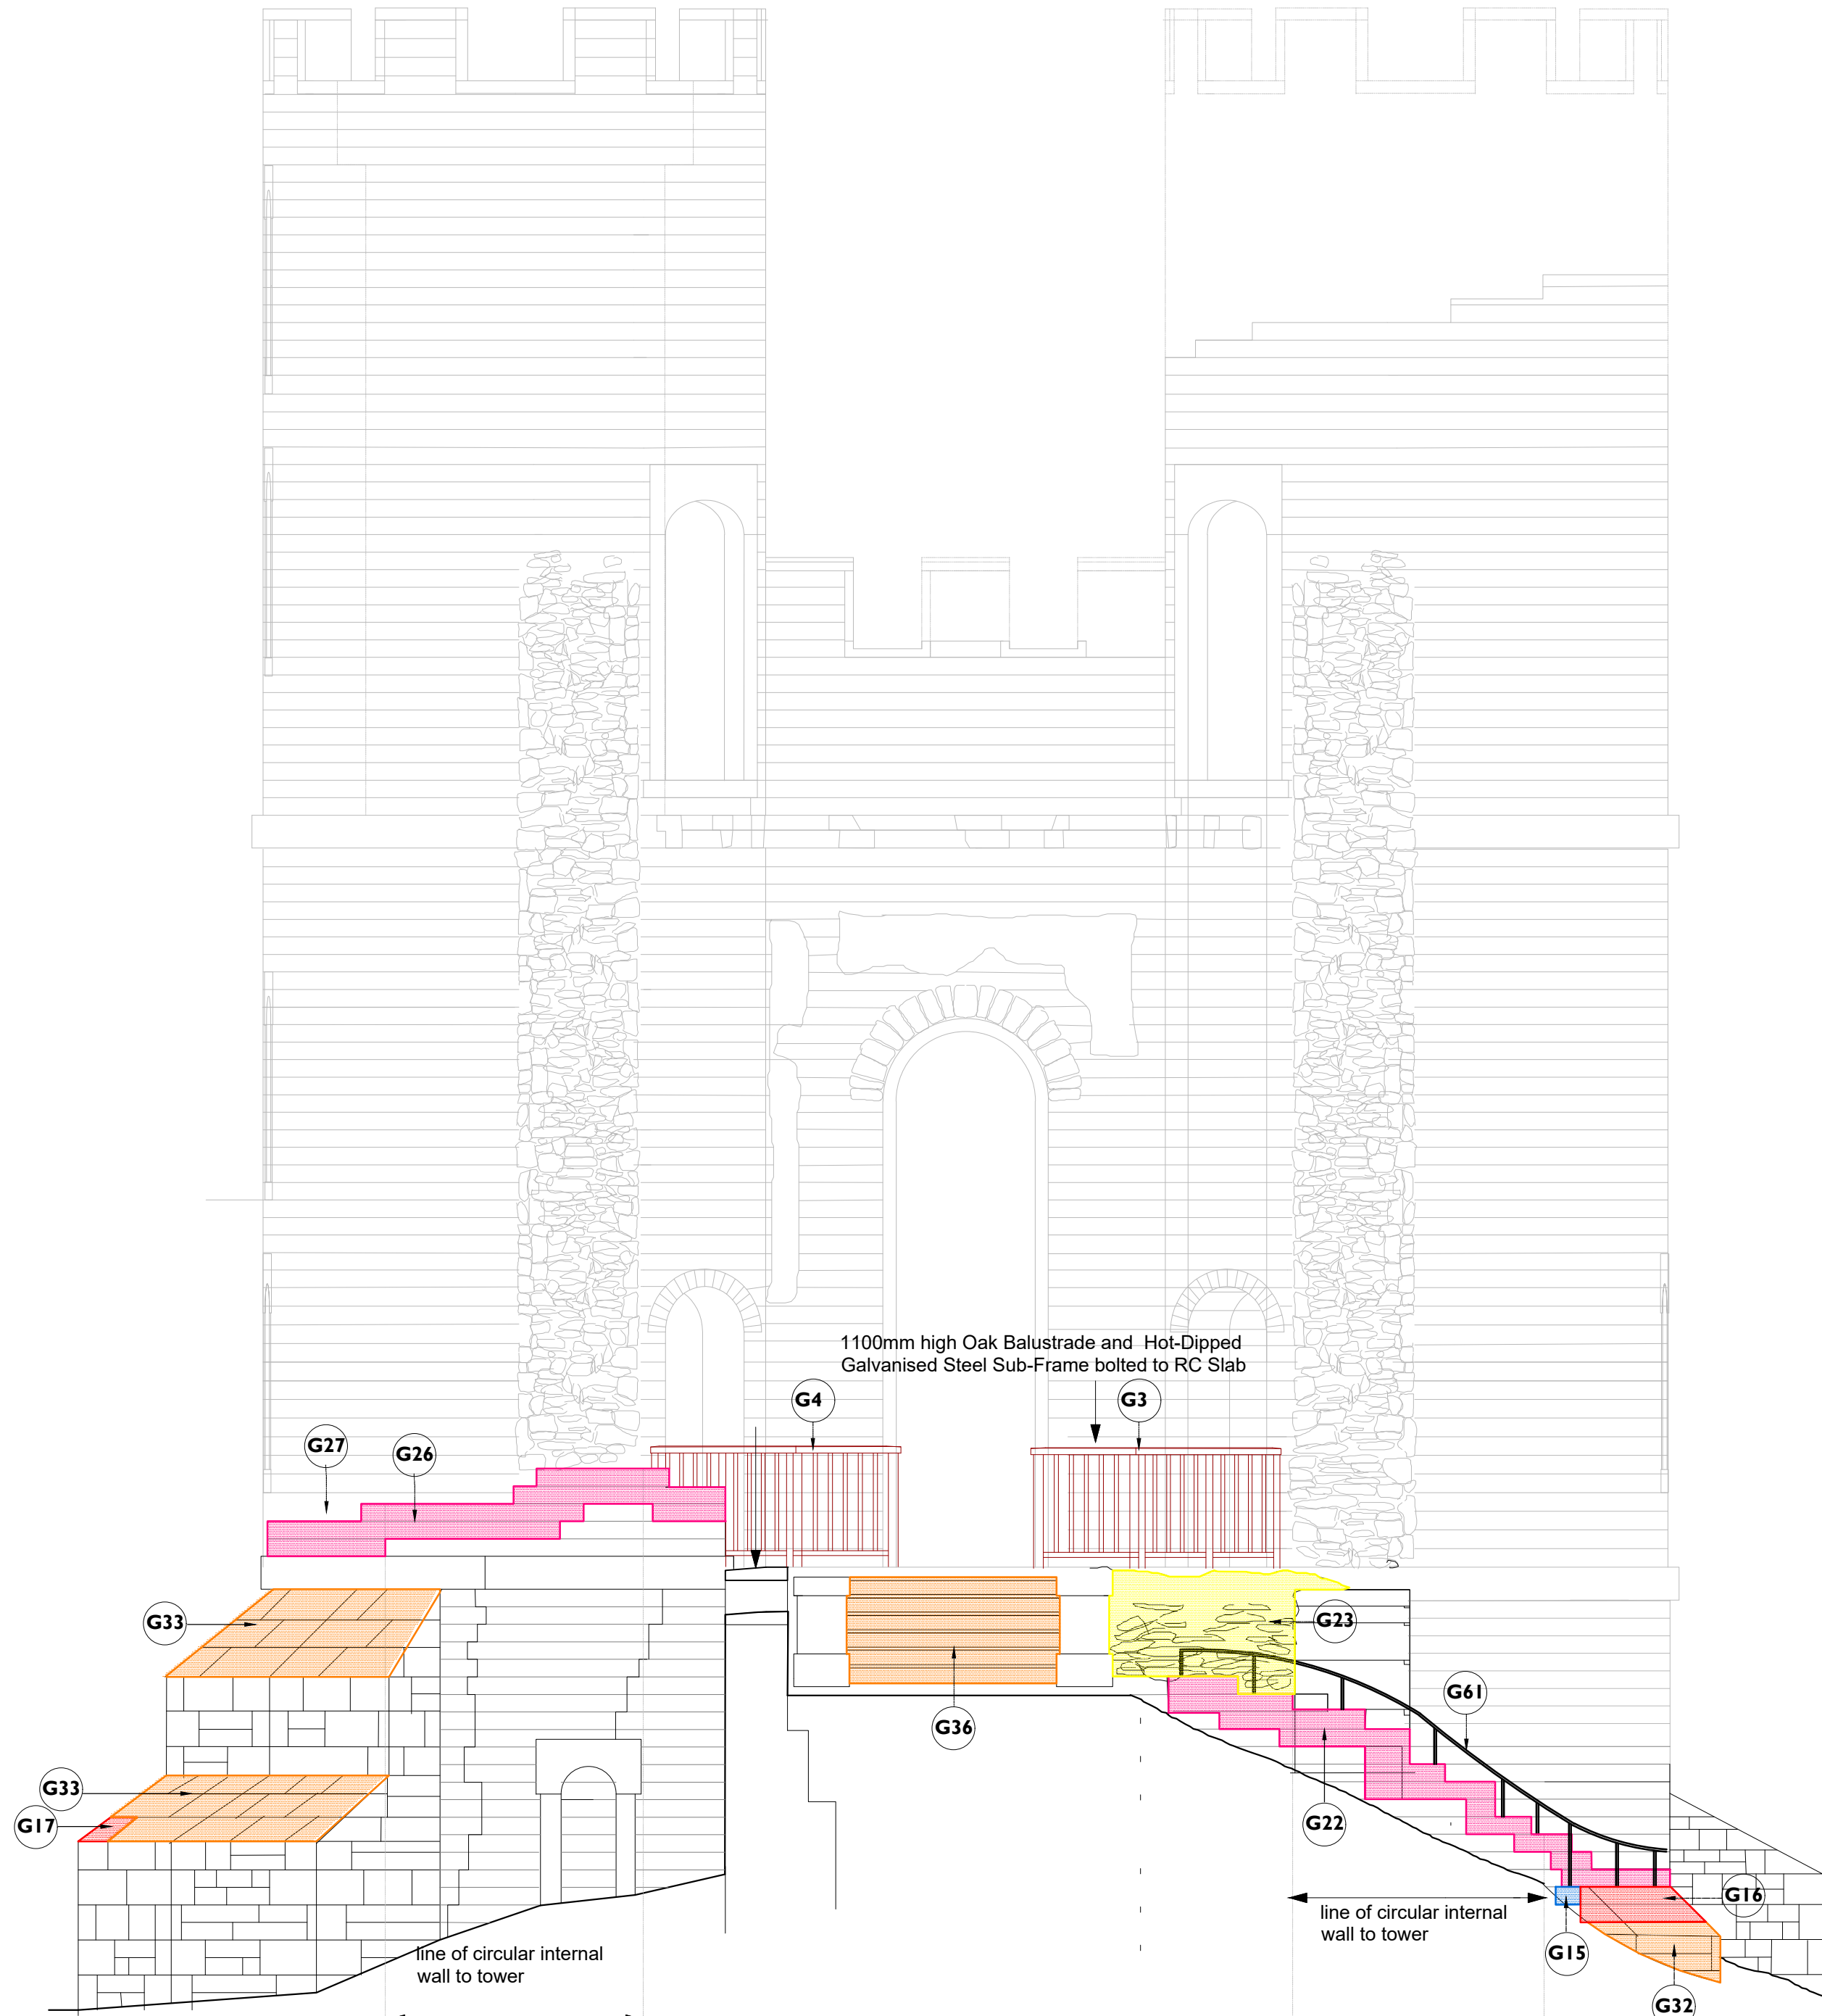

GATEHOUSE TOWER GT4

GATEHOUSE TOWER GT3

NORTH ELEVATION

Notes:

Drawings are based on survey data and may not accurately represent what is physically present.

Do not scale from this drawing. All dimensions are to be verified on site before proceeding with the work.

All dimensions are in millimeters unless noted otherwise.

Purcell shall be notified in writing of any discrepancies.

KEY			
■	Re-bed existing stone	■	Pinning to delaminated stone face
■	Replacement stone	■	Render repair
■	Re-point square faced stone/rubble stone walling	■	Mortar packing to cavernously eroded stone
■	Deep pointing/consolidation of rubble stone	■	Remove woody shrubs
■	Re-bed top 2no courses of square faced stone		

0 500mm 1 m 2 m 3 m 4 m 5 m				
Scale 1:50				
Current	11-10-19	EH	SS	
ISSUE	DATE	DRAWN	CHECKED	DESCRIPTION

CLIENT	National Trust
PROJECT	Wentworth Castle and Stainborough Park 2019
240169-PUR-ZZ-00-DR-A-2005	

DRAWING TITLE	Gatehouse
SIZE & SCALE	A1L 1:50 @ A1
DRAWING STATUS	S2 - For Information

JOB NUMBER	240169
DRAWING NO.	2005
REVISION	P01

