



## A. Tree pit detail within soft landscape areas (semi mature and extra heavy standard trees)

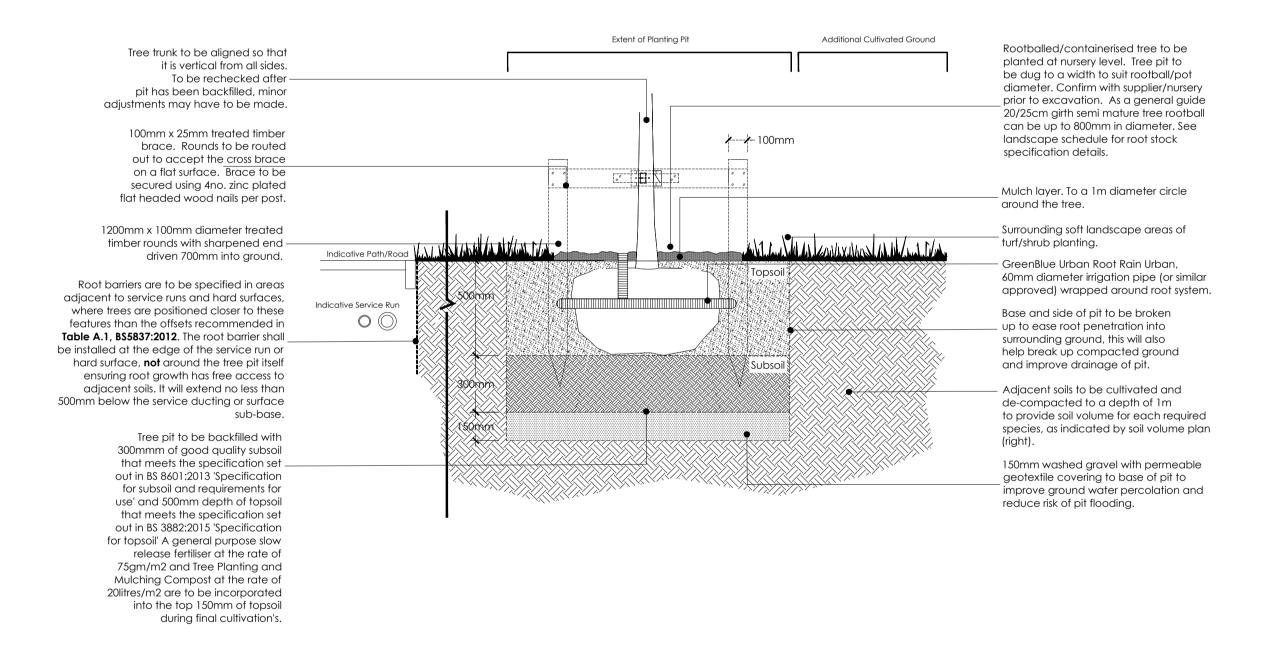


## C. Tree pit detail within soft landscape areas (with root barriers)

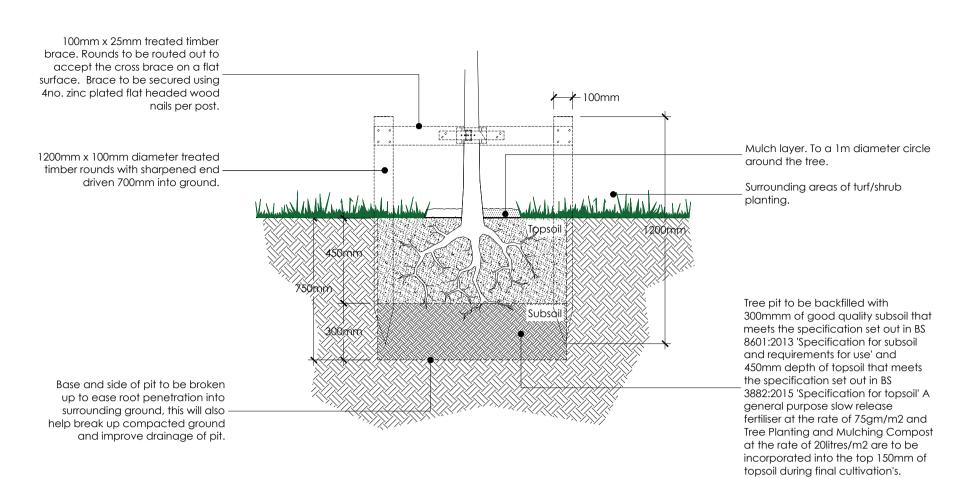


B. Tree pit detail within soft landscape areas (heavy and select standard trees)

## NOTES


- The Landscape Contractor is responsible for identifying all services below ground prior to the excavation of any tree pit. If plans are not available then detection equipment must be used, if there is a conflict between the pit position and services the Site Manager must be informed.
- All arisings from tree pit excavation must be removed either to an area identified by the Site Manager or to an approved tip off site.
- If services run close to the tree pit (within 3m) then a suitable root barrier must be installed to the side of the pit. The barrier must fit to both the width and depth of the pit, a sample or details of the proposed barrier must be submitted for approval.
- Above ground staking system must be approved if planting semi mature or extra heavy tree stock. Only to be used for trees in less prominent locations following review with client.
- Prior to installation the rootball anchoring system/staking details must be submitted for approval.
- All tree pits must be backfilled with topsoil in accordance with BS 3882: 2015 'Specification for topsoil ' and BS 8601:2013 'Specification for subsoil and requirements for use'. If soil has not been supplied by site then approved soil must be imported to site, all certificates must be handed to the Site Manager on delivery.
- All works must be completed in accordance with the detail.
- An aftercare programme must be agreed with the region to ensure that the tree is monitored and watered on a regular basis.
- Until technical approval has been granted from the relevant Authority, it should be understood that all drawings issued are preliminary and NOT for construction. Should the contractor commence site work prior to such approval being given, it is entirely at his own risk.



Excavate tree pit to the specified depth and a width that will accommodate the proposed rootball/pot, minimum width 800mm.

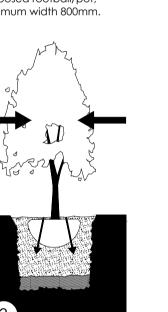

Plant rootballed/containerised tree at nursery level in accordance with above detail using an approved staking system. Ensure that tree is vertical.



Break up and loosen material to the sides of the pit, in particular the base of the pit to avoid leaving heavily compacted ground.



Water tree to field capacity following planting works, trees must be checked and watered on a regular basis.

