



Key Plan 1:1250

- 80. Existing non-load bearing masonry wall unstable due to lack of effective head restraint. To be removed and replaced with new blockwork partition with head restraint.
- 81. Later brickwork flue removed disconnected / de-bonded from original chimney to be removed before instability becomes dangerous.

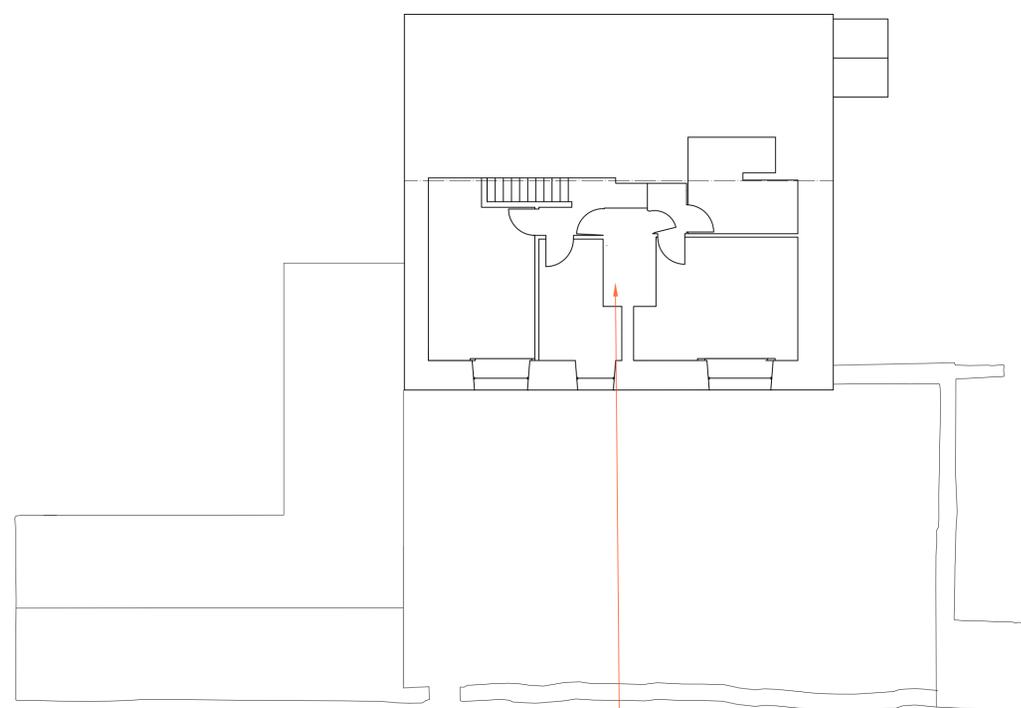

81 80

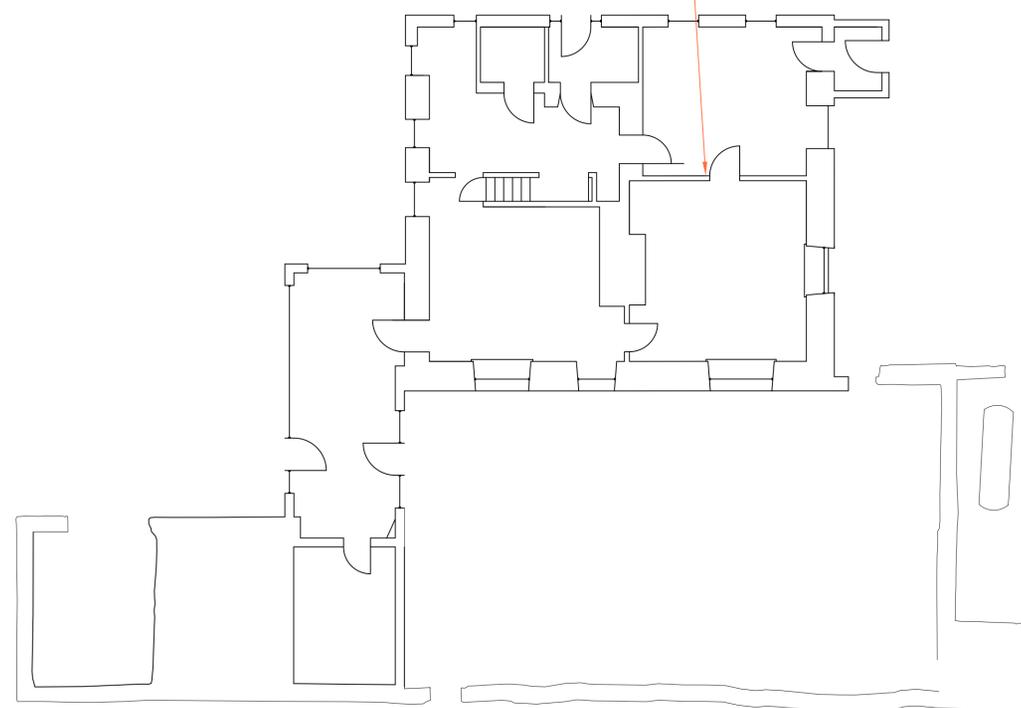

This drawing incorporates information from 3rd parties and its veracity is restricted accordingly.

Robin Ashley Architects

Hawk Works, 105 Mary Street,
Sheffield, S1 4RT
t: 0114 258 7450
e: contact@raarchitects.co.uk
www.raarchitects.co.uk



project: Far Westhorpe Farm

client: Mr David Pearson
drawing: Cottage #1
Work to historic fabric

drawing number: **24-39-302**

revision: A (17/02/2026)

date: November 25

scale: 1:100

original size: A1

issue: Approval

drawn: DJU

checked: DJU

this drawing may be scaled only for the purposes of planning approval
check all dimensions on site + refer all queries prior to carrying out work
this drawing is to be used only for the purposes for which it is issued
© robin ashley architects LLP
registered in england + wales, number OC310 421

