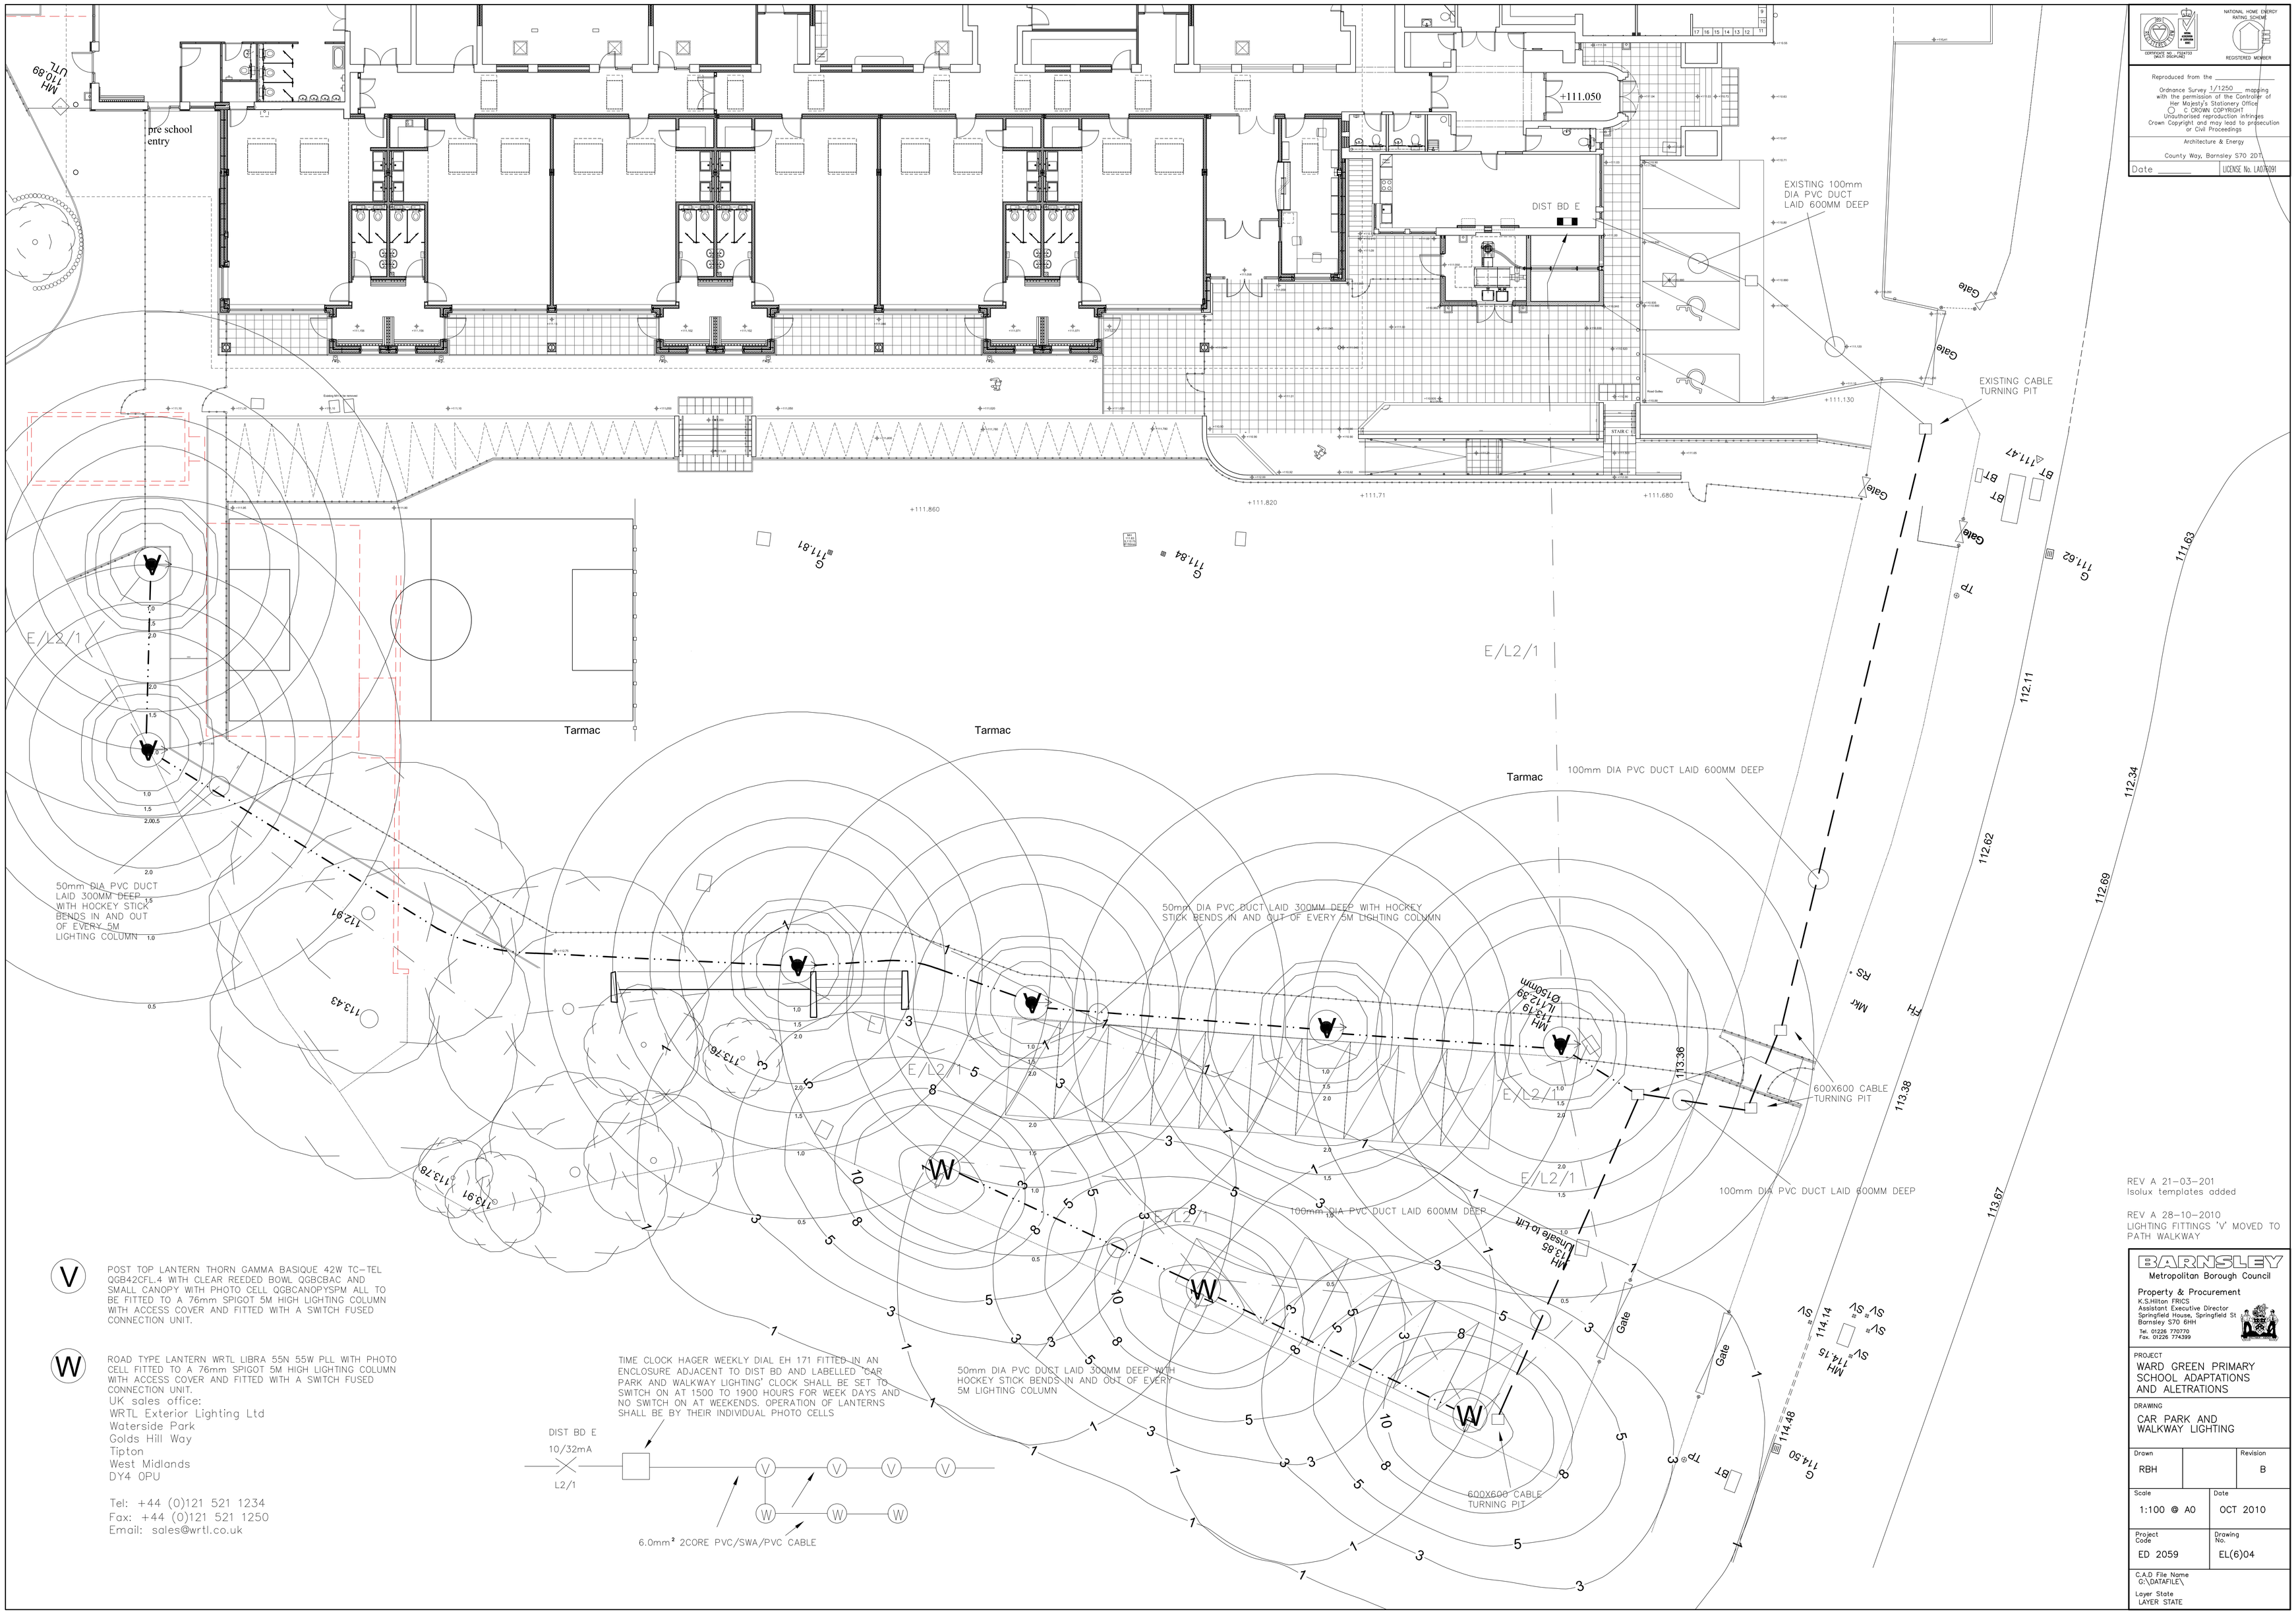
pre school entry
DIST BD E
EXISTING 100mm DIA PVC DUCT LAID 600MM DEEP
EXISTING CABLE TURNING PIT
Tarmac
Tarmac
Tarmac
100mm DIA PVC DUCT LAID 600MM DEEP
50mm DIA PVC DUCT LAID 300MM DEEP WITH HOCKEY STICK BENDS IN AND OUT OF EVERY 5M LIGHTING COLUMN
50mm DIA PVC DUCT LAID 300MM DEEP WITH HOCKEY STICK BENDS IN AND OUT OF EVERY 5M LIGHTING COLUMN
600X600 CABLE TURNING PIT
100mm DIA PVC DUCT LAID 600MM DEEP
100mm DIA PVC DUCT LAID 600MM DEEP
600X600 CABLE TURNING PIT
E/L2/1
Gate
Gate
Gate
Gate
Gate
+111.050
+111.130
+111.860
+111.820
+111.71
+111.680
111.62
111.63
112.11
112.34
112.62
112.69
113.36
113.38
113.67
114.14
114.48
114.50
TIME CLOCK HAGER WEEKLY DIAL EH 171 FITTED IN AN ENCLOSURE ADJACENT TO DIST BD AND LABELLED 'CAR PARK AND WALKWAY LIGHTING' CLOCK SHALL BE SET TO SWITCH ON AT 1500 TO 1900 HOURS FOR WEEK DAYS AND NO SWITCH ON AT WEEKENDS. OPERATION OF LANTERNS SHALL BE BY THEIR INDIVIDUAL PHOTO CELLS
DIST BD E
10/32mA
L2/1
6.0mm² 2CORE PVC/SWA/PVC CABLE
V
W
POST TOP LANTERN THORN GAMMA BASIQUE 42W TC-TEL QGB42CFL.4 WITH CLEAR REEDED BOWL QGBCBAC AND SMALL CANOPY WITH PHOTO CELL QGBCANOPYSPM ALL TO BE FITTED TO A 76mm SPIGOT 5M HIGH LIGHTING COLUMN WITH ACCESS COVER AND FITTED WITH A SWITCH FUSED CONNECTION UNIT.
ROAD TYPE LANTERN WRTL LIBRA 55N 55W PLL WITH PHOTO CELL FITTED TO A 76mm SPIGOT 5M HIGH LIGHTING COLUMN WITH ACCESS COVER AND FITTED WITH A SWITCH FUSED CONNECTION UNIT.
UK sales office:
WRTL Exterior Lighting Ltd
Waterside Park
Golds Hill Way
Tipton
West Midlands
DY4 0PU
Tel: +44 (0)121 521 1234
Fax: +44 (0)121 521 1250
Email: sales@wrtl.co.uk
REV A 21-03-201
Isolux templates added
REV A 28-10-2010
LIGHTING FITTINGS 'V' MOVED TO PATH WALKWAY
BARNSLEY
Metropolitan Borough Council
Property & Procurement
K.S.Hilton FRICS
Assistant Executive Director
Springfield House, Springfield St
Barnsley S70 6HH
Tel. 01226 770770
Fax. 01226 774399
PROJECT
WARD GREEN PRIMARY SCHOOL ADAPTATIONS AND ALETRATIONS
DRAWING
CAR PARK AND WALKWAY LIGHTING
Drawn
RBH
Revision
B
Scale
1:100 @ A0
Date
OCT 2010
Project Code
ED 2059
Drawing No.
EL(6)04
C.A.D File Name
C:\DATAFILE\
Layer State
LAYER STATE
NATIONAL HOME ENERGY RATING SCHEME
REGISTERED MEMBER
Reproduced from the Ordnance Survey 1/1250 mapping with the permission of the Controller of Her Majesty's Stationery Office
© CROWN COPYRIGHT
Unauthorised reproduction infringes Crown Copyright and may lead to prosecution or Civil Proceedings
Architecture & Energy
County Way, Barnsley S70 2DT
Date
LICENSE No. LA078358